


- ① — WATER SUPPLY LOCATION
- ② — STORAGE AREA UNDERGROUND
- ③ — WASTE ROCK DISPOSAL
- ④ — FEEDER BREAKER LOCATION
- ⑤ — POWER CENTER LOCATION
- ⑥ — FIRE PROOF ENCLOSURE
- ⑦ — TRAVEL THRU DOORS
- ⑧ — STOPPING WITH MANDOOK



LAYOUT SCALE: 1"=120'

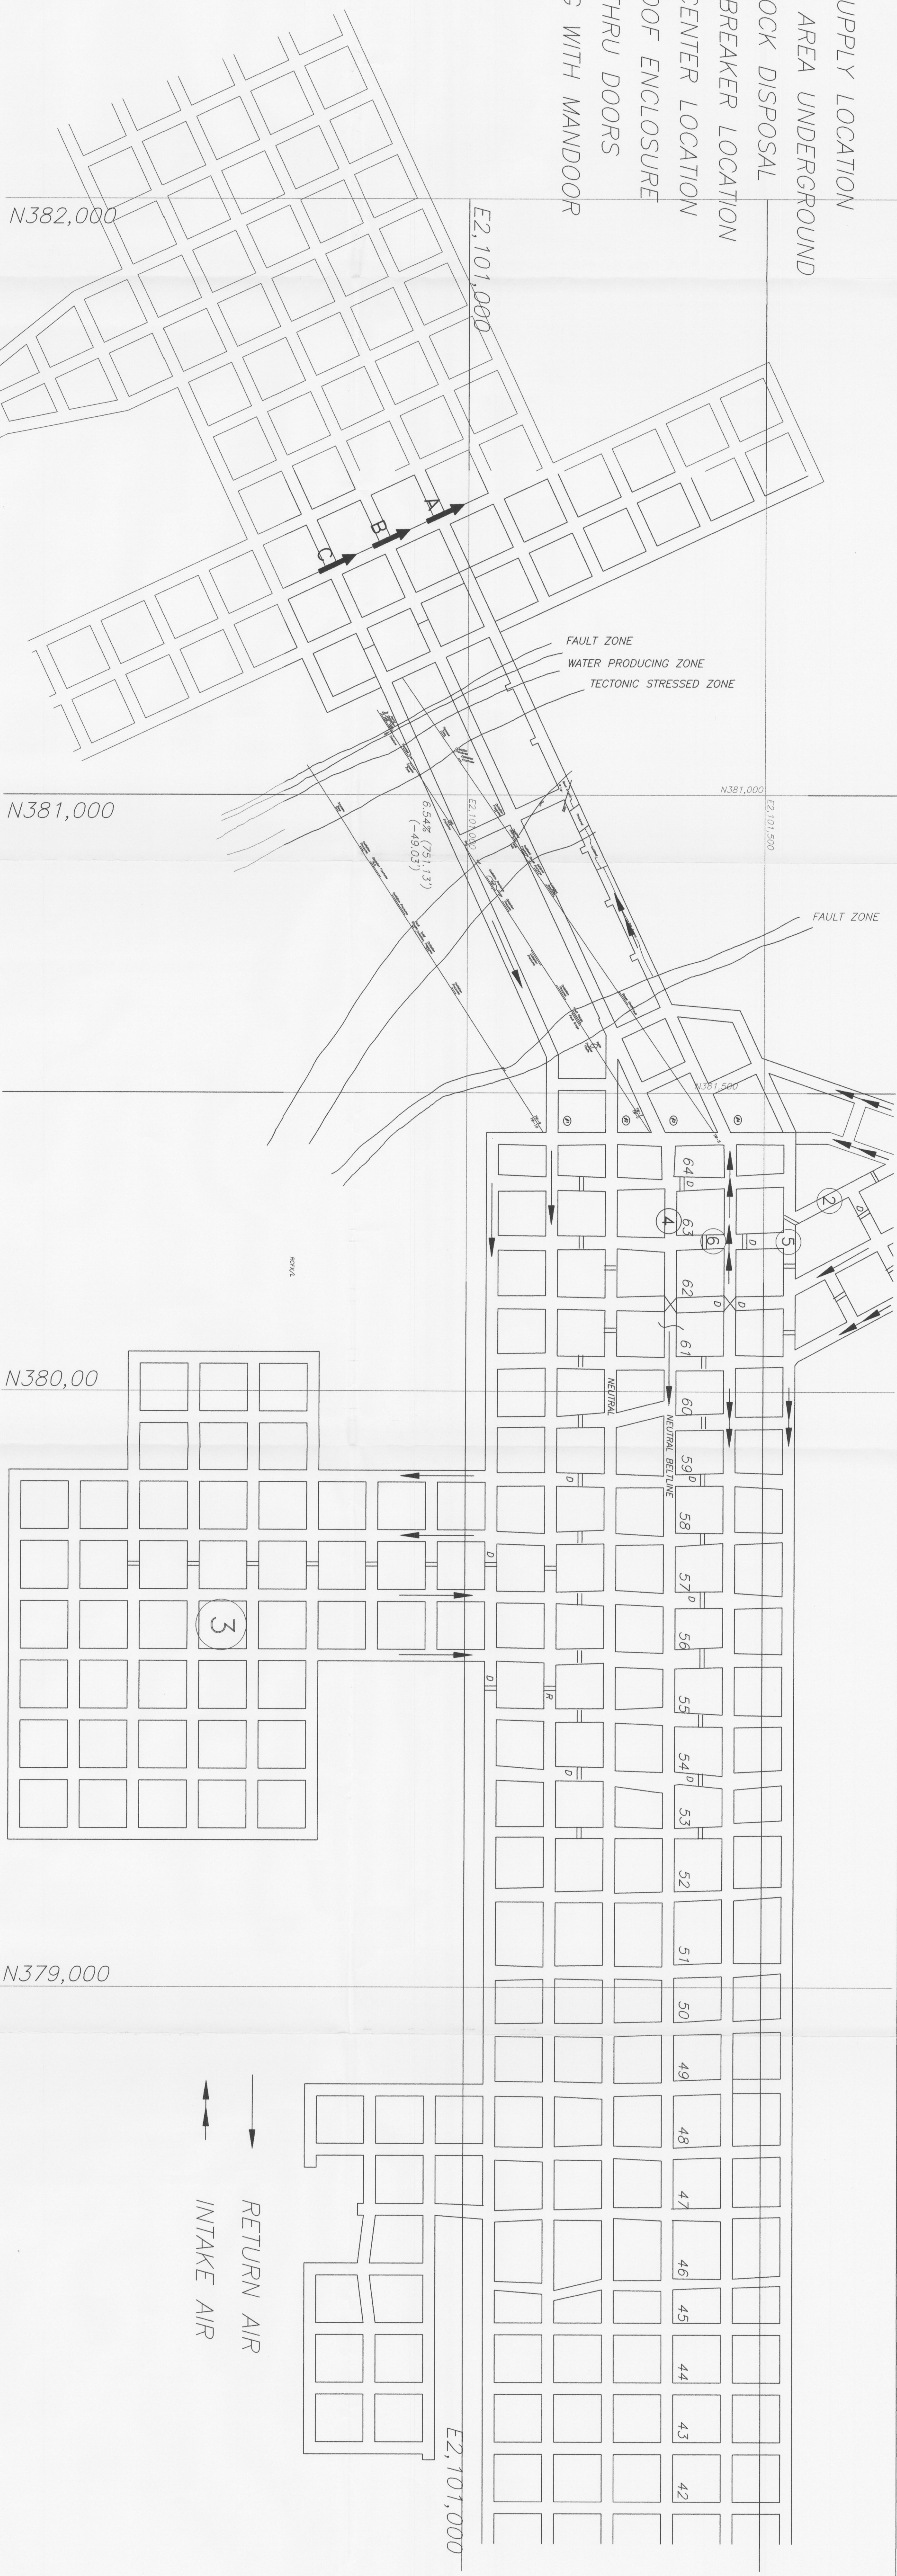

PROFILE SCALE: 1"=30'

SECTION C-C
FIGURE 4C

JRG	REMOVED CONTRIBUTION LINES TO LAYOUT	7/17/89
JRG	ADDED CORRELATION LINES TO LAYOUT	3/9/89
JRG	CHANGED LOCATION OF ROADS AND ENTRIES	2/14/89
JRG	REMOVED CROSS-SECTIONS AND CHANGED THE GRADE IN ALL ENTRIES	12/30/86
JRG	REVISED CROSS-SECTIONS	11/10/88
JRG	REMOVED JAIL PRESENCE ENTRIES	9/9/88
JRG	REMOVED JAIL PRESENCE ENTRIES AND SECTION C'S GRADE	9/9/88
JRG	SECTION C REVISION	DATE

UTAH POWER & LIGHT

MINE DIVISION

P.O. BOX 146000 SALT LAKE CITY, UT 84114

ROANS CANYON FAULT CROSSING
ROCK TUNNEL LAYOUT
AND PROFILES

DRAWN BY: J. GARRETT

SCALE: AS NOTED

C.M.-10784-D.R.

PRINTING PLT. 1 1 6

7/13/90